



# Upward Fire Spread Rate Over Real-Scale EPS ETICS Façades

*Biao Zhou\**, School of Emergency Management and Safety Engineering, China University of Mining & Technology (Beijing), Beijing 100083, China and Department of Architecture, Faculty of Engineering, The University of Tokyo, Tokyo 113-8654, Japan

*Hideki Yoshioka*, Department of Fire Engineering, Building Research Institute, Tsukuba, Ibaraki 305-0802, Japan

*Takafumi Noguchi*, Department of Architecture, Faculty of Engineering, The University of Tokyo, Tokyo 113-8654, Japan

*Kai Wang*, School of Emergency Management and Safety Engineering, China University of Mining & Technology (Beijing), Beijing 100083, China

*Xinyan Huang* , Department of Building Services Engineering, The Hong Kong Polytechnic University, Hong Kong, China

**Received:** 6 September 2020/**Accepted:** 9 February 2021/**Published online:** 13 March 2021


**Abstract.** The expanded polystyrene (EPS) façade has been widely used to save building energy, but it has also caused many severe facade fire accidents worldwide. Especially for aged buildings, the naturally weathered exterior surface layer can further increase the facade fire risk and the fire spread rate (FSR). In this work, a series of real-scale EPS External Thermal Insulation Composite System (ETICS) façades are tested via the JIS A 1310 standard. The EPS thickness varies from 100 to 300 mm, density changes from 15 kg/m<sup>3</sup> to 30 kg/m<sup>3</sup>, and heat release rate (HRR) of window spilled flame ranges from 600 kW to 1100 kW. Tests showed that the surface cement layer was quickly damaged by a spilled flame that provided negligible fire resistance for the internal flammable EPS panel. The measured upward FSR increases with the rising of HRR and with the decreasing EPS thickness like the thermally thin material. An empirical correlation of instantaneous upward FRS is proposed,  $FSR = 0.22\Phi + 3.45$  [cm/min], where  $\Phi$  is a modified fire propagation index derived from the experimental temperature distribution. In addition, a simple prediction method for FSR is proposed for the façade fire and verified by the experimental data. This work provides a useful method to quantify the upward façade fire propagation, which also helps evaluate the fire risk and hazard of EPS ETICS façade prior to the costly large-scale tests and installation.

---

\*Correspondence should be addressed to: Biao Zhou, E-mail: [zhoubiao1088@gmail.com](mailto:zhoubiao1088@gmail.com); Xinyan Huang, E-mail: [xy.huang@polyu.edu.hk](mailto:xy.huang@polyu.edu.hk)



## Graphic Abstract

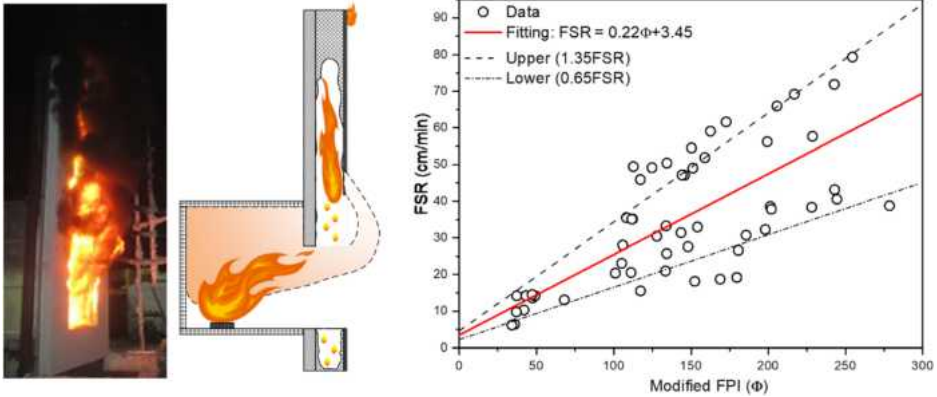

**Keywords:** Vertical flame spread, Window spilled flame, Empirical correlation, JIS A 1310 standard

## Abbreviations

<i>CM</i>	Cement mortar
<i>EPS</i>	Expanded polystyrene foam
<i>ETICS</i>	External Thermal Insulation Composite System
<i>FPI</i>	Fire propagation index $[(m/s^{1/2})/(kW/m)^{2/3}]$
<i>FSR</i>	Fire spread rate [cm/min]
<i>HRR</i>	Heat release rate [kW]
<i>IHFFS</i>	Incident heat flux upon the facade's surface $[kW/m^2]$
<i>PCM</i>	Polymer cement mortar
<i>PE</i>	Polyethylene
<i>SBR</i>	Styrene-butadiene rubbers-latex
<i>TRP</i>	Thermal Response Parameter $[kW \cdot s^{1/2}/m^2]$
$\overline{FSR}$	The averaged FSR of different positions [cm/min]

## List of Symbols

$A$	The window opening area $[m^2]$
$A_T$	The inner surface area of chamber $[m^2]$
$C_p$	Specific heat $[J/(kg \cdot K)]$
$H$	The height of window opening [m]
$k$	Thermal conductivity $[W/(m \cdot K)]$
$L_{EPS}$	EPS thickness [mm]
$\dot{Q}_0$	Critical window fire intensity for HRR out of chamber [kW]
$\dot{Q}_{ch}$	Chemical heat release rate per unit width $[kW/m]$
$r_0$	New length scale
$T_0$	Ambient temperature [K]
$T_{ig}$	Surface ignition temperature [K]
$T_g$	Steady temperature of window fire opening [K]
$T_z$	Maximum surface temperature for each position [K]

**Greeks Letters**

$\rho$	Density [kg/m <sup>3</sup> ]
$\Theta$	Dimensionless temperature profile

**1. Introduction**

Today large fires associated with façade systems in tall buildings are currently occurring at a rate of more than once a month globally [1]. These façade fires are and are responsible for many deaths and billions of dollars in losses, such as the tragic event of the Grenfell Tower fire in 2017, and the facade flammability are still a major building fire safety concern. One the most common façade system, External Thermal Insulation Composite Systems (ETICS), has been widely used in buildings due to their thermal advantages, low cost, and ease of application [2, 3]. A typical ETICS is consisted of the wall construction, insulation material, cement bound mortar with reinforcement, and rendering and is fixed by dowels and mortar [4]. The flammable insulation materials, like expanded polystyrene (EPS) and polyurethane (PU) foams, are often used. In China, many façade fires have happened in EPS ETICS in different regions from the north to south, such as the 2009 TVCC fire and 2010 Shanghai fire.

It is well known that EPS ETICS is quite flammable, which consists of adhesive, EPS insulation material, cement, reinforcing mesh, finishing coat [5]. For the aged EPS ETICS façade, the fire resistance of polymer cement mortar (PCM) layer becomes weak after it is deteriorated by the environment, so that fire risk of EPS ETICS may increase as time goes by. A complex fire behavior, including EPS melt-flow and dripping has been reported when EPS ETICS specimens exposed to a fire [6]. The fire spread rate (FSR) of EPS ETICS has been observed to be fast, but the measurements and data of FSR on building façade still lack today.

The EPS ETICS fire has been one of the hot and challenging topics in building facade fire. Nevertheless, the high cost of large-scale fire tests and the strong influence of scale effect have limited the deeper understanding of EPS ETICS fire research. Fire characteristics of a single component have been reported, such as EPS [7–10], adhesive [11], polymer-modified concrete [12, 13], and finishing coat reaction-to-fire performance [14, 15]. However, it is not sufficient to use the reaction-to-fire performance of a single component to evaluate fire hazards of any façade system [16]. Regarding the whole ETICS, its fire behavior has been discussed in the aspects of fire spread assessment [5, 17–19], fire safety during different process stages [20], fire rescue analysis [21], fire barrier influence on reaction-to-fire performance [22], and incident heat flux upon the facade's surface (IHFFS) and damage of the facade's render [19, 23], vertical temperature distribution [24, 25], EPS thickness [26–28], fire evaluation methods after test [29] and so on. However, more fundamental knowledge of vertical FSR of EPS ETICS masonry façade fire over the exterior building wall is urgently needed.

In this work, a series of real-scale EPS ETICS façade specimens differing parameters are tested under various HRR of window spilled flame, EPS thickness,

and thermal parameters of ETICS according to the JIS A1310 method. We investigate the temperature history of façade fire exposed to a window spilled fire and propose an empirical method to predict the FSR of a façade fire.

## 2. Experiment and Method

### 2.1. JIS A 1310 Façade Fire Test


The experiment method adopted the Japanese Industrial Standards JIS A 1310 façade fire test method [30]. The test setup and EPS ETICS specimens are illustrated in Fig. 1. The experimental layout is shown in Fig. 1a, and a simple sketch of the experiment is detailed in Fig. 1b. The facade fire test facility consisted of a propane gas combustion chamber (size in  $L \times W \times H = 1350 \text{ mm} \times 1350 \text{ mm} \times 1350 \text{ mm}$ ), window opening (size in  $L \times W = 910 \text{ mm} \times 910 \text{ mm}$ ), gas burner (size in  $L \times W = 600 \text{ mm} \times 600 \text{ mm}$ ), specimen substrate and specimen support frame. The opening size and opening aspect  $n$  ( $n = 2 W/H$ ) were  $W \times H = 910 \text{ mm} \times 910 \text{ mm}$  and  $n = 2$ , respectively. The chamber had an inner surface area of  $10.1 \text{ m}^2$ .

The various propane window spilled flames were produced by a gas burner. The gas burner was filled with ceramic beads to ensure the propane gas with a uniform speed. The specimen substrate was made by laying 2 pieces of 12-mm thick calcium silicate board, and the joint of the first layer was not overlapped with the joint of the second layer. The specimen support frame made of stainless steel was employed to support the specimen and its substrate. The interior surface of the chamber was coated by a 25-mm thick ceramic fiber blanket. The temperature histories of both façade surface (1st front layer,  $T_S$ ) and calcium silicate board (2nd back layer,  $T_B$ ) were recorded by a series of K-type thermocouples on the finishing coat surface in the height of 0 m ( $T_0$  for temperature), 0.50 m ( $T_1$ ), 0.90 m ( $T_2$ ), 1.50 m ( $T_3$ ), 2000 mm ( $T_4$ ) and 2500 mm ( $T_5$ ) above the top of the opening, respectively. The K-type thermocouple with a 3-mm bead has an accuracy of  $\pm 2.2^\circ\text{C}$ . The arrangement and locations of thermocouples are shown in Fig. 1c.

The heat release rate (HRR) was calculated by the common methodology of Oxygen Consumption Calorimetry. A gas-analysis equipment was used to record oxygen concentration ranged from 0.009% to 20.9% every 2 s. The gas analyzer had an accuracy of  $\pm 0.02\%$ . Before the façade fire test, 4-L alcohol was burnt to calibrate the whole measuring system. Repeatability of the experimental setup had been verified previously [29]. Details of EPS ETICS specimens and testing conditions are listed in Table 1.

### 2.2. Test Parameters

All EPS ETICS specimens were prepared by the same standard method, which were consisted of polymer cement mortar (PCM), cement mortar (CM), reinforcement mesh layer, and EPS foam. All experiments were conducted in the Building Research Institute of Japan, located in the Tsukuba of Japan. Four EPS thickness ( $L_{EPS}$ ), 100 mm, 150 mm, 200 mm, and 300 mm, as well as two densities of EPS

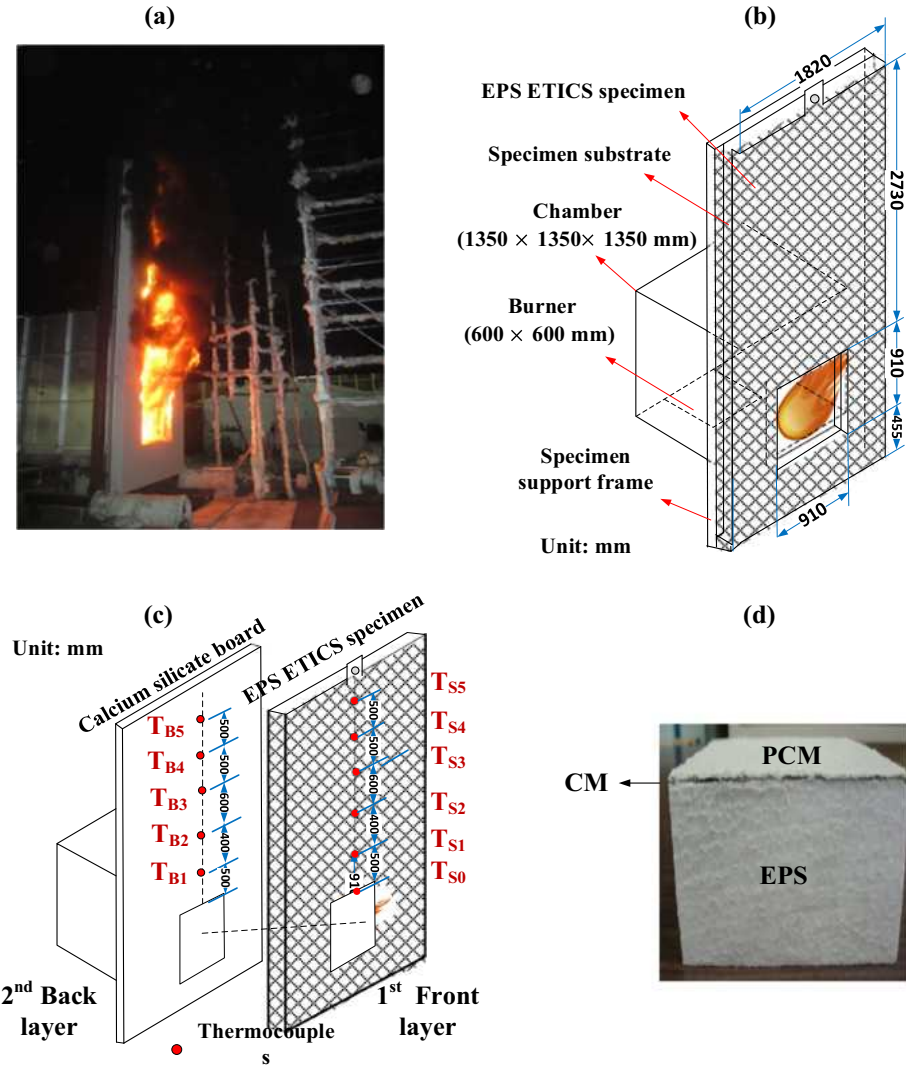

**Figure 1. The description of the experiment (a) The layout of test configurations (b) a sketch model of experiment layout (c) thermocouple configuration (d) the details of EPS ETICS configuration.**

foam  $15 \text{ kg/m}^3$  to  $18 \text{ kg/m}^3$  were tested. Four HRR values from  $600 \text{ kW}$  to  $1100 \text{ kW}$  were chosen for the propane gas burner (see Table 1). All opening edges of EPS ETICS specimens were treated by the back-wrapping method (see more details in reference [31]). A thermocouple was located in the ceiling of the chamber to monitor the inner temperature of the chamber.

Although the spilled flame attached to the façade surface and grew higher, initially, it imposed little influence on the EPS panel, since it was coated with a non-

**Table 1**  
**Details of EPS ETICS specimens and testing conditions, where all specimens are performed with one layer of reinforcement mesh. The PCM layer is contained with SBR**

Test no	EPS thickness (mm)	EPS density (kg/m <sup>3</sup> )	HRR (kW)
1	100	18	1000
2	100	15	1100
3	150	15	900
4	200	15	1100
5	200	18	1000
6	200	18	600
7	300	18	600
8	100	15	600
9	100	15	900
10	100	30	900
11	200	15	900

The opening treatment method is back-wrapping

combustible CM layer. The upward fire spread occurred on the flammable EPS panel, but the location of the flame inception on the façade surface was difficult to identify. On the other hand, once the EPS foam is directly heated by the flame, it will quickly melt and shrink by the surface tension, and the backside can be almost instantaneously heated by the flame. Therefore, in this work, we define the arrival of the fire front at the moment when the EPS back temperature ( $T_B$ ) had a sudden increase. Then, we can define FSR as

$$FSR = \frac{L_i}{t_i} \quad (1)$$


where  $L_i$  is the location of backside thermocouple ( $i$ ) changing from 0.5 m to 2.5 m, and  $t_i$  is the preheating time for the façade at each position  $L_i$  in Fig. 1c.

### 3. Results and Discussion

For all facade fire tests, it was found that when the HRR of window spilled flame increases from 600 kW to 1100 kW, the ceiling temperature of the chamber (Inside chamber) approached a fixed value. In all cases, the spilled flame, as an indicator of flashover, was observed, so that the tested compartment fire was post-flashover or fully-developed fire.

#### 3.1. Phenomena of EPS ETICS Façade Fire


Figure 2 illustrates the development of the compartment fire, the ignition of the façade, and the upward spread of the façade fire, based on test No. 4 (1100 kW fire with 200-mm thick EPS). The supplemental video shows a typical fire test pro-

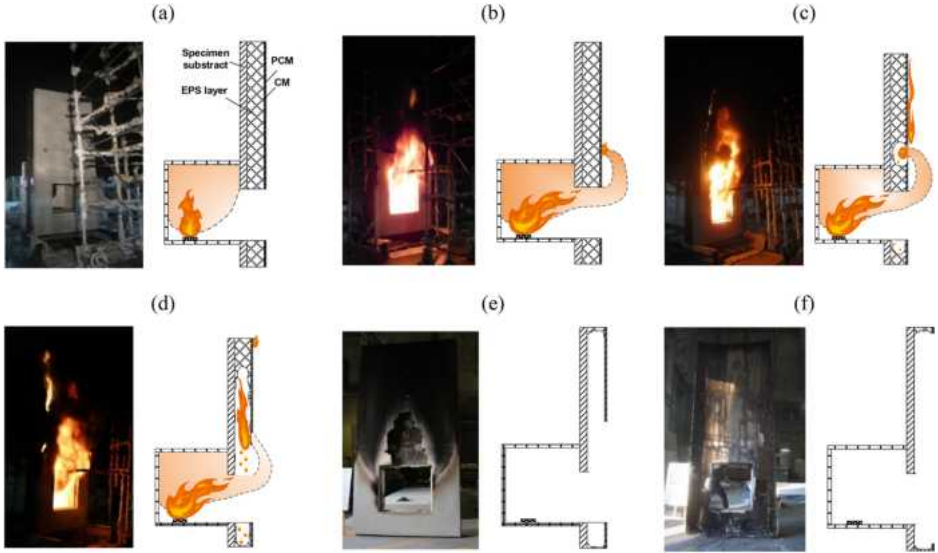

**Figure 2. The description of façade fire tests, (a) Early stage at  $t = 1$  s, (b) flame spilled out at  $t = 24$  s, (c) ignition of EPS and the formation of hole in CM layer at  $t = 95$  s, (d) upward flame propagation at  $t = 326$  s, (e) EPS burnout outlook, and (f) removal of façade.**

cess. With the development of the compartment fire (Fig. 2a), the flame spilled out through the window opening and attached to the ETICS surface wall (Fig. 2b). When the hot flame got in contact with on façade surface, the PCM layer would be ignited soon, because of the combustible nature of styrene-butadiene rubbers-latex (SBR). Soon after, the CM layer became damaged by window spilled flames (Fig. 2c). Then, flames came into the EPS layer to ignite a new fire, which started to spread both upward and downward [32] (Fig. 2d). The upward fire spread was dominant and much faster. The downward fire spread was accompanied by dripping ignition of molten EPS [6, 33]. Finally, most of the fuels were burnt out, so the fire became weak. After about 20 min, the flame disappeared, and a big hole was found above the opening (Fig. 2e). No remaining EPS was found when the residual surface was removed (Fig. 2f).

The corresponding front-surface and backside thermocouple temperatures of test No. 4 are detailed in Fig. 3. Taking  $T_{S5}$  (the uppermost one) in Fig. 3a as an example, it reaches the 1st peak at  $t = 95$  s due to the initial ignition of the PCM layer and the following fire propagation. After the burnout of PCM,  $T_{S5}$  starts to decrease slightly. As the surface temperature quickly exceeded  $800^{\circ}\text{C}$  that is hot enough to decompose the cement cover (or CM layer). Quickly afterward, a hole between 0.90 m ( $T_{S2}$ ) and 1.50 m ( $T_{S3}$ ) was formed as the CM layer was severely damaged by the direct impact of spilled flame, as illustrated in Fig. 2c. For  $T_{S5}$ , the 2nd peak appeared at  $t = 326$  s was ascribed to the EPS fire or the combus-

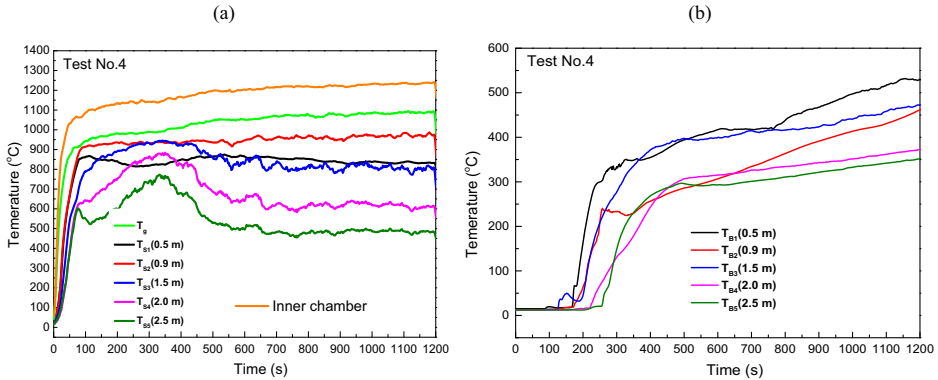

**Figure 3. The surface and back temperature histories of No.4 varying with test time, (a) surface temperature ( $T_S$ ), and (b) back temperature ( $T_B$ ).**

tion of styrene gas, that is, the main pyrolysis product of EPS [34]. The measured peak surface temperature, in general, decreased with the height from 1090°C ( $T_{S0}$ ) to 765°C ( $T_{S5}$ ).


For the preheat time ( $t$ ) for the backside thermocouples in test No. 4 (Fig. 3b), they were 165 s ( $T_{B1}$  at 0.50 m), 172 s ( $T_{B2}$  at 0.90 m), 192 s ( $T_{B3}$  at 1.50 m), 220 s ( $T_{B4}$  at 2.00 m) and 254 s ( $T_{B5}$  at 2.50 m), respectively. Afterward, their temperatures started to rapidly increase above 200°C without any drop, indicating the direct impact of the flame and the ignition of foam. These preheat time values will be used to calculate the transient and average upward FSR.

### 3.2. Upward Fire Spread Rate (FSR)

The dependence of FSR with various test parameters are summarized in Fig. 4, and the experimental data are listed in Tables 2 and 3. As expected, the upward FSR is not constant, but increases almost linearly with the time or the development of fire, as shown in Fig. 4a. In other words, the acceleration of FSR in each case is almost a fixed value. To simplify the comparison, the average value ( $-FSR$ ) is used to study the influence of other fire and material parameters.

Figure 4b shows that the averaged FSR decreases greatly as the thickness of EPS increases. Specifically, as the thickness increases from 100 to 200 mm, the value of  $-FSR$  almost decreases half. This behavior is the same as the “thermally-thin material,” although the thicknesses of EPS are several orders of magnitude greater than the conventional limit of thermally thin (about 2 mm). This is attributed to the quick shrinkage of EPS foam in contact with the flame, as well as the serious melt-flow or melt-drip phenomena that happened inside the ETICS (see more detailed temperature data in Table 3).

In addition, the averaged FSR increases with the HRR rising of window spilled flame (see Fig. 4c). A greater HRR indicates a stronger flame heating, and the spilled flame length, which is attached to the ETICS surface, also increases with

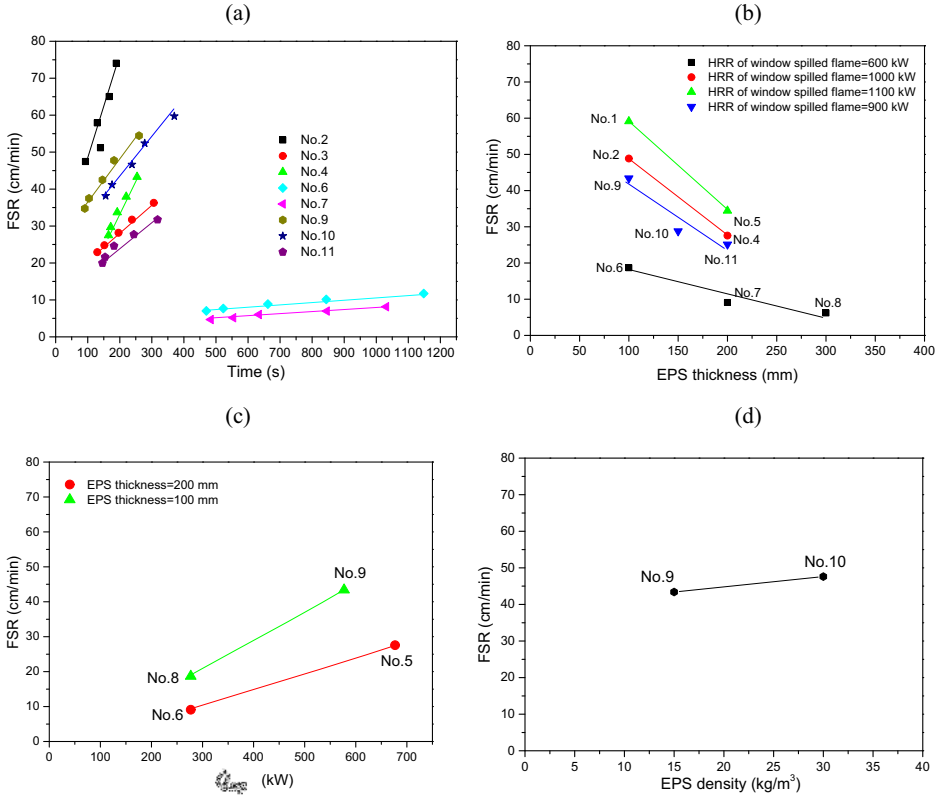

**Figure 4. The description of FSR varying test time, EPS thickness, HRR and EPS density, (a) FSR versus test time (b) –FSR versus  $L_{EPS}$  (c) –FSR versus  $\dot{Q}_{sp}$  (d) –FSR versus  $\rho_{EPS}$ .**

HRR. Compared to the effect of thickness, –FSR is almost insensitive to the density of EPS, as shown in Fig. 4d. It is probably because the density of EPS is quite small, and the density variation does not affect the quick melting and shrinkage behaviors. Some study in the literature has also showed that density has a minimal effect on the ignition of low-density EPS foam [9].

### 3.3. Correlation of Instantaneous FSR Versus Modified FPI ( $\Phi$ )

The EPS ETICS façade fire is a comprehensive phenomenon that is greatly affected by fire intensity of compartment fire (e.g., HRR), spilled flame, opening treatment method, EPS thickness, material properties and so on [26, 34, 35]. Thereby, not a single parameter can determine the instantaneous FSR in the early stage of the façade fire, as well as the fire performance of the EPS ETICS.

The window spilled flame is a common ignition source of the exterior building wall [36]. The HRR of the compartment fire ( $\dot{Q}$ ) includes the part confined inside

**Table 2**  
**Temperature over calcium silicate board and the heat penetration time for each position during façade fire tests**

Test no	T <sub>B1</sub> (°C)	T <sub>B2</sub> (°C)	T <sub>B3</sub> (°C)	T <sub>B4</sub> (°C)	T <sub>B5</sub> (°C)	t <sub>1</sub> (s)	t <sub>2</sub> (s)	t <sub>3</sub> (s)	t <sub>4</sub> (s)	t <sub>5</sub> (s)	FSR (cm/min)
1	436	352	262	212	196	160	203	160	313	387	48.86
2	520	472	533	374	364	93	140	130	167	189	59.13
3	438	387	454	283	262	130	152	196	238	306	28.78
4	531	462	471	370	350	165	172	192	220	254	34.42
5	477	377	331	251	273	107	257	256	394	451	27.56
6	236	267	220	88	18	470	523	662	844	1148	9.09
7	234	220	177	115	80	484	554	634	846	1031	6.21
8	231	158	147	30	157	147	348	350	435	/	18.68
9	422	313	266	287	165	91	104	146	182	260	43.39
10	559	555	546	327	244	156	176	238	278	370	47.62
11	514	436	331	283	227	146	154	182	244	318	25.13

the chamber and the residue released out of chamber. The critical HRR confined in the chamber ( $\dot{Q}_{v,crt}$  in kW) could be calculated as [37]

$$\dot{Q}_{v,crt} = 150 \left( \frac{A_T}{A\sqrt{H}} \right)^{\frac{2}{3}} A\sqrt{H} \quad (2)$$

which only depends on the compartment configuration and is 323 kW for the current chamber. Then, the HRR of window spilled flame ( $\dot{Q}_{sp}$  in kW) is

**Table 3**  
**Peak surface temperature varying test time during façade fire tests**

Test no	T <sub>g</sub> (°C)	T <sub>S1</sub> (°C)	T <sub>S2</sub> (°C)	T <sub>S3</sub> (°C)	T <sub>S4</sub> (°C)	T <sub>S5</sub> (°C)
1	1122	882	775	648	514	376
2	1044	1023	990	856	693	637
3	1068	942	893	766	598	491
4	1090	865	973	943	888	765
5	1078	1004	647	895	699	644
6	992	905	678	547	517	313
7	1045	670	580	573	450	391
8	946	498	394	323	282	245
9	1126	938	883	754	554	465
10	1089	985	923	785	564	558
11	1066	902	893	878	725	561

$$\dot{Q}_{sp} = \dot{Q} - \dot{Q}_{v,crt} \quad (3)$$

which is a key index for the evaluation of the reaction-to-fire performance of façade specimens. Specifically, for the  $\dot{Q}$  of 600 kW, 900 kW the  $\dot{Q}_{sp}$  is.

The upward FSR at the initial stage should be related to the HRR of the window spilled fire as

$$FSR \sim \dot{Q}_{sp} \sim (\dot{Q} - \dot{Q}_{v,crt}) \quad (4)$$

which is most valid when the spilled flame is small.

Previously, the fire propagation index (FPI) was used to evaluate the potential of vertical fire propagation by using the following equation [38]:

$$FSR \sim FPI = 750 \frac{(\dot{Q}'_{ch})^{\frac{1}{3}}}{TRP} \quad (5)$$

The thermal response parameter (TRP) is

$$TRP = \left(\frac{\pi}{4} k \rho c_p\right)^{\frac{1}{2}} (T_{ig} - T_0) \quad (6)$$

where  $T_{ig} - T_0 = 220^\circ\text{C}$  for the PCM contained SBR latex. However, this FPI may not be valid for the EPS ETICS. For example, Fig. 4d shows that the density has a negligible effect on the FSR.

Thus, based on the analysis above and our previous work [39], we proposed a modified FPI ( $\Phi$ ) to evaluate the upward fire propagation potential of EPS ETICS as

$$\Phi = FPI \left(\frac{\dot{Q} - \dot{Q}_{v,crt}}{L_{EFS}}\right) \left(\frac{T_z}{T_g}\right)^{\frac{2}{3}} \left(\frac{T_g - T_0}{T_z - T_0}\right) \quad (7)$$


where  $T_z$  is the real-time surface temperature  $T_S(t)$ , and  $T_g$  is the real-time window gas temperature. In this work, the value of  $\Phi$  ranges from 30 to 280 for the HRR of from 600 kW to 1100 kW.

The correlation between the instantaneous FSR and  $\Phi$  is shown in Fig. 5. The best-fitting correlation for all FSR data is


$$FSR = 0.22\Phi + 3.45 \quad (8)$$

where most of the experimental data are within  $\pm 35\%$  of this correlation. To predict the FSR, and should be estimated first.

Figure 6 further shows the influence of EPS foam thickness under different compartment-fire HRRs; that is, FRS increases as the EPS thickness decreases. In addition, when the HRR of window spilled flame is low, the FSR trend agrees

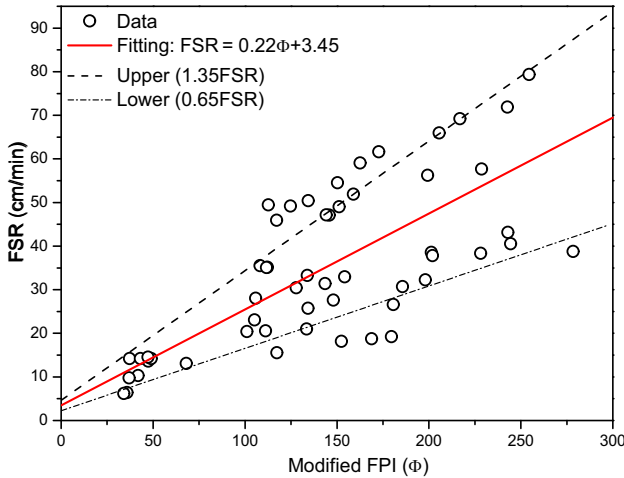

**Figure 5. The relationship between FSR of each position and modified FPI ( ).**

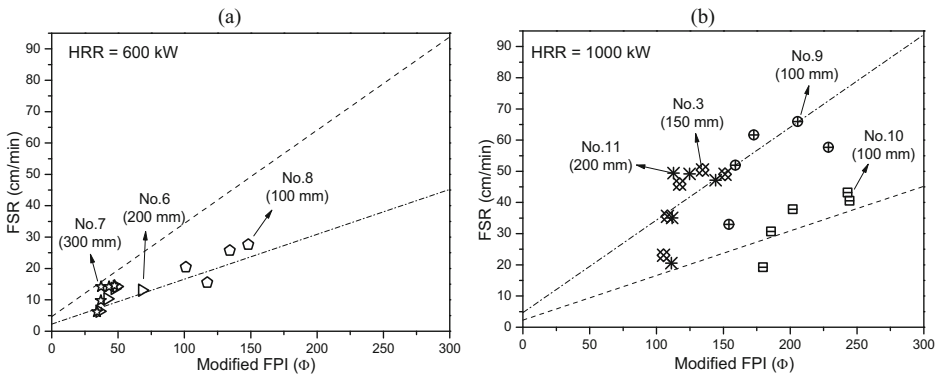


**Figure 6. The influence of HRR on FSR versus, (a) 600 kW, and (b) 1000 kW.**

with the lower boundary. The influence of EPS thickness on FSR vs. is given in Fig. 7. A comparison of results indicates that EPS thickness imposes a serious effect on FSR. Considering the uncertainty of the real-scale façade fire test and the complexity of the reaction-to-fire performance of EPS ETICS, the FSR could be averaged approximately and adequately by the averaged trajectory.

### 3.4. A Prediction Method for FSR Prior to Real-Scale Tests

3.4.1. A Dimensionless Temperature Profile ( $\Theta_c$ ) The vertical temperature distribution ( $\Theta'$ ) over façade surface imposed by a window spilled flame has been proposed in our recent work [25] as

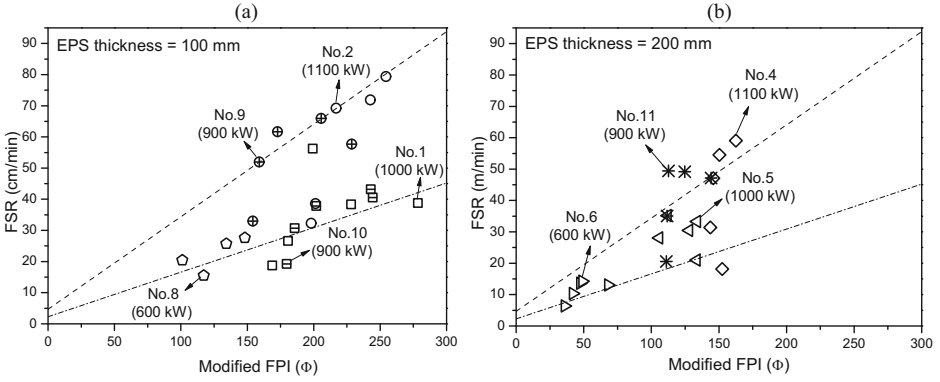

**Figure 7. The influence of EPS thickness on FSR versus (a) 100 mm (b) 200 mm.**

$$\Theta' = \frac{\Delta T_z r_0'^{\frac{5}{3}}}{\left(\frac{\dot{Q}^2 T_\infty}{\rho_z^2 c_p^2 g}\right)^{\frac{1}{3}} n^{\frac{1}{6}}} = \frac{0.45}{(1-x)^{\frac{1}{6}}} \left(\frac{T_g}{T_z}\right)^{\frac{2}{3}} \left(\frac{T_z - T_0}{T_g - T_0}\right) = F\left(\frac{z}{r_0'}\right) \quad (9)$$

where the neutral plane is calculated by the equation  $x = \frac{z_0}{H} = \frac{1}{1+1.04\left(\frac{T_g}{T_0}\right)^{1/3}}$ . The new length scale  $r_0'$  was defined as  $r_0' = \sqrt{\frac{W(1-x)H}{\pi}}$ , where  $x$  is the ratio of neutral plane position  $z_0$  to the window opening height  $H$ . Without this assumption, the location of the neutral plane is a constant at  $0.5H$ .

The vertical temperature over the facade surface varies with the HRR of window spilled flames and the fire propagation potential of facade materials. Then, the correlation between dimensionless  $\Theta_c$  and  $\frac{z}{r_0'}$  is proposed by incorporating the FPI [29], as proposed and verified in our previous work [24]:

$$\Theta_c = \frac{\Theta'}{\sqrt{FPI}} = \frac{0.45}{(1-x)^{\frac{1}{6}}} \left(\frac{T_g}{T_z}\right)^{\frac{2}{3}} \left(\frac{T_z - T_0}{T_g - T_0}\right) FPI^{-\frac{1}{2}} = F\left(\frac{z}{r_0'}\right) \quad (10)$$

Regarding EPS ETICS façade, dimensionless  $\Theta_c$  is approximated to be a nearly linear relationship with  $\frac{z}{r_0'}$  based on test results. An adequate approximation is  $\frac{z}{r_0'} = -180 \times \Theta_c + 17.3$ .

3.4.2. Proposal of a Prediction Method for FSR Based on the above discussion and Eq. (10), we have  $FSR \propto \Phi$  that can be further expressed as

$$FSR \propto FPI \left(\frac{Q - Q_{v,crt}}{L_{EPS}}\right) \left(\frac{T_z}{T_g}\right)^{\frac{2}{3}} \left(\frac{T_g - T_0}{T_z - T_0}\right) \quad (11)$$

According to Eq. (9), we have

$$\left(\frac{T_g}{T_z}\right)^{\frac{2}{3}} \left(\frac{T_z - T_0}{T_g - T_0}\right) = \frac{\Theta_c \sqrt{FPI}}{0.45} (1-x)^{\frac{1}{6}} \tag{12}$$


Then, Eq. (11) is changed as:

$$FSR \propto \sqrt{FPI} \left(\frac{Q - Q_{v,crt}}{L_{EPS}}\right) \frac{0.45}{\Theta_c (1-x)^{\frac{1}{6}}} \tag{13}$$

To propose a simple method for calculating the vertical FSR in the facade,  $FSR = 0.22\Phi + 3.45$  is used. Finally, the FSR [cm/min] becomes

$$FSR = \frac{Q - Q_{v,crt}}{L_{EPS} (1-x)^{\frac{1}{6}}} \times \frac{39.6\sqrt{FPI}}{17.3 - \frac{z}{r_0}} + 3.45 \tag{14}$$

which can predict the early-stage FSR of EPS ETICS prior to façade fire. The necessary parameters are  $z, r_0, FPI, x, Q, Q_{v,crt}$  and  $L_{EPS}$ , which are easy to obtain with respect to a fixed test condition. For simplification,  $x = 0.5$  can be used for calculation.

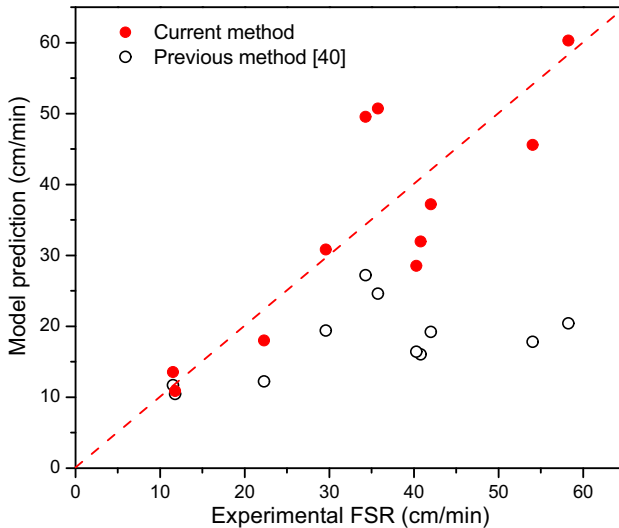

**Figure 8. The deviation between experimental and calculated FSR by using two methods.**

### 3.5. Comparison of Prediction Methods

In our previous work, a calculation method for FSR on the basis of test results from a series of tests is given [39]. When  $L_{EPS} \leq 0.3$  m,  $Q \leq 1100$  kW, and  $17.3 \leq FPI \leq 31.3$  (m/s<sup>1/2</sup>)/(kW/m)<sup>2/3</sup>, FSR in [cm/min] could be predicted by

$$FSR = 100 \exp \left[ \left( 1.56 FPI \frac{Q - Q_{v,crit}}{L_{EPS}} - 0.045 \right) t - 2.2 \right] \quad (15)$$

In this work, a new calculation method (current method) is proposed based on considering the HRR of window spilled flame and thermal parameters of EPS ETICS. We can predict FSR with  $t$ ,  $FPI$ ,  $Q$ ,  $L_{EPS}$  by Eq. (12). The comparison of experimental and calculated data is shown in Fig. 8. It indicates the result performed by the current method shows a better agreement with experimental data. In general, the agreement is much increased by using the current method. Thus, the current method is adequately approximated for engineering applications.

## 4. Conclusions

In this work, FSR of EPS ETICS facades exposed to different window spilled fires are discussed on the basis of a series of real-scale fire tests according to the JIS A 1310 façade standard test method. Tests showed that the surface CM layer only provided a small fire resistance for the internal flammable EPS panel. Once the CM layer was damaged by spilled flame locally, the EPS panel would be quickly ignited. The measured upward FSR increases with the rising of HRR and with the decreasing EPS thickness like the thermally thin material.

A dimensionless parameter  $\Phi = FPI \left( \frac{\dot{Q} - \dot{Q}_{v,crit}}{L_{EPS}} \right) \left( \frac{T_z}{T_g} \right)^{\frac{2}{3}} \left( \frac{T_g - T_0}{T_z - T_0} \right)$  is defined to quantify the instantaneous FSR, and all tests in this work satisfy  $FSR = 0.22\Phi + 3.45$  [cm/min]. With the measured ETICS temperature profile, the FSR can be predicted as  $FSR = \frac{Q - Q_{v,crit}}{L_{EPS}(1-x)^{\frac{1}{6}}} \times \frac{39.6\sqrt{FPI}}{17.3 - \frac{7}{r_0}} + 3.45$ . This work provides a useful method to quantify the upward façade fire propagation, which also helps evaluate the fire risk and hazard of EPS ETICS façade prior to expensive tests.

## Acknowledgements

The authors gratefully acknowledge Masamichi Tamura (University of Tokyo), Yutaka Tanaike (University of Tokyo), Yuhei Nishio (Tokyo University of Science), Miki Nakamura, and Yusuke Kanda (Tokyo University of Science) for preparation of the experiment and the help in the experimental operation. The authors thank Tetsuya Hayakawa (Tokyo System Vac., Inc.) for the Cone tests. This work is supported by “the Fundamental Research Funds for the Central Universities” No. 2020XJAQ03.

## Supplementary Information

The online version contains supplementary material available at <https://doi.org/10.1007/s10694-021-01103-3>.

## References

1. Bonner M, Rein G (2018) Flammability and multi-objective performance of building façades: Towards optimum design. *Int J High-Rise Build* 7:363–374
2. Nishio Y, Yoshioka H, Noguchi T, Kanematsu M, Ando T, Hase Y et al (2016) Fire spread caused by combustible facades in Japan. *Fire Technol* 52:1081–1106
3. Barreira E, de Freitas VP (2013) Experimental study of the hygrothermal behaviour of external thermal insulation composite systems (ETICS). *Build Environ* 63:31–39
4. Nilica R, Harmuth H (2005) Mechanical and fracture mechanical characterization of building materials used for external thermal insulation composite systems. *Cem Concr Res* 35:1641–1645
5. Mandilaras I, Atsonios I, Zannis G, Founti M (2014) Thermal performance of a building envelope incorporating ETICS with vacuum insulation panels and EPS. *Energy Build* 85:654–665
6. Zehfuß J, Northe C, Riese O (2018) An investigation of the fire behavior of ETICS facades with polystyrene under fire loads of different size and location. *Fire Mater* 42:508–516
7. Wang ZZ, Huang ZY, Yang T (2020) Silica coated expanded polystyrene/cement composites with improved fire resistance, smoke suppression and mechanical strength. *Mater Chem Phys* 240:7
8. Collier PCR, Baker GB (2013) The influence of construction detailing on the fire performance of polystyrene insulated panels. *Fire Technol* 49:195–211
9. Wang S, Huang X, Chen H, Liu N, Rein G (2015) Ignition of low-density expandable polystyrene foam by a hot particle. *Combust Flame* 162:4112–4118
10. Wessies SS, Chang MK, Marr KC, Ezekoye OA (2019) Experimental and analytical characterization of firebrand ignition of home insulation materials. *Fire Technol* 55:1027–1056
11. Chen YF, Yang L, Zhuang S (2014) Study on the combustion characteristic of adhesive polystyrene. *Appl Mech Mater* 664:191–193
12. Muthadhi A, Kothandaraman S (2013) Experimental investigations on polymer-modified concrete subjected to elevated temperatures. *Mater Struct* 47:977–986
13. Zhang HY, Kodur V, Wu B, Cao L, Wang F (2016) Thermal behavior and mechanical properties of geopolymer mortar after exposure to elevated temperatures. *Constr Build Mater* 109:17–24
14. Berardi U, Meacham BJ, Dembsey NA, You Y-G (2014) Fire performance assessment of a fiber reinforced polymer wall panel used in a single family dwelling. *Fire Technol* 50:1607–1617
15. Nguyen QT, Tran P, Ngo TD, Tran PA, Mendis P (2014) Experimental and computational investigations on fire resistance of GFRP composite for building façade. *Compos B Eng* 62:218–229
16. Khan AA, Lin S, Huang X, Usmani A (2021) Facade fire hazards of bench-scale aluminum composite panel with flame-retardant core. *Fire Technol* (in press)

17. Mikkola E, Hakkarainen T, Matala A (2013) Fire safety of EPS insulated facades in residential multi-storey buildings. *In: MATEC Web of Conferences: EDP Sciences*; p. 04002
18. Hofmann A, Kaudelka S, Hauswaldt SJF (2018) Fire safety of FAÇADES with polystyrene foam insulation. *Fire Mater* 42:466–474
19. Hajduković M, Knez N, Knez F, Kolšek J (2017) Fire performance of external thermal insulation composite system (ETICS) facades with expanded polystyrene (EPS) insulation and thin rendering. *Fire Technol* 53:173–209
20. Antonatus E (2013) Fire safety of etics with EPS material properties and relevance for fire safety during transport, construction and under end use conditions in external thermal insulation component systems. *In: MATEC Web of Conferences: EDP Sciences*; p. 02008
21. Kumm M, Söderström J, Lönnermark A (2013) EPS insulated façade fires from a fire and rescue perspective. *In: MATEC Web of Conferences: EDP Sciences*; p. 05003
22. Bjegovic D, Pecur IB, Messerschmidt B, Milovanovic B, Alagusic M (2016) Influence of fire barriers on fire performance of facades with combustible insulation. *In: MATEC web of conferences: EDP Sciences*; p. 05006
23. Kotthoff I, Hauswaldt S, Riese O, Riemesch-Speer J (2016) Investigations of the performance of facades made of ETICS with polystyrene under external fire exposure and fire safety measures for their improvement. *In: MATEC Web of Conferences: EDP Sciences*; p. 02007
24. Zhou B, Yoshioka H, Noguchi T, Wang K. Experimental study on vertical temperature profile of EPS external thermal insulation composite systems masonry façade fire according to JIS A 1310 method.n/a
25. Zhou B, Yoshida M, Noguchi T, Ando T (2020) Experimental study on vertical temperature profile of buoyant window spill plume from intermediate-scale compartments. *Fire Mater* 44(4):516–529
26. Zhou B, Yoshioka H, Noguchi T, Ando TJF (2018) Effects of opening edge treatment and EPS thickness on EPS external thermal insulation composite systems (ETICS) façade reaction-to-fire performance based on JIS A1310 standard façade fire test method. *Fire Mater* 42:537–548
27. Yoshioka H, Nishio Y, Tamura M, Yoshida M, Noguchi T, Ohmiya Y et al (2014) Façade tests on fire propagation along combustible exterior wall systems. *Fire Sci Technol* 33:1–15
28. Nishio Y, Yoshioka H, Noguchi T, Ando T, Tamura M (2013) Experimental study on fire propagation over combustible exterior facades in Japan. *In: MATEC Web of Conferences: EDP Sciences*; p. 04001
29. Zhou B, Yoshioka H, Noguchi T, Ando T (2018) Experimental study of expanded polystyrene (EPS) external thermal insulation composite systems (ETICS) masonry façade reaction-to-fire performance. *Therm Sci Eng Prog* 8:83–92
30. JIS A 1310 Standard Test (2015) Test method for fire propagation over building facades
31. Zhou B, Yoshioka H, Noguchi T, Ando T (2017) Effects of opening edge treatment and EPS thickness on EPS external thermal insulation composite systems (ETICS) façade reaction-to-fire performance based on JIS A1310 standard façade fire test method. *Fire Mater* 42(5):537–548
32. Zhou B, Yoshioka H, Noguchi T, Ando TJTS, Progress E (2018) Experimental study of expanded polystyrene (EPS) external thermal insulation composite systems (ETICS) masonry façade reaction-to-fire performance. *Therm Sci Eng Prog* 8:83–92

33. Sun P, Lin S, Huang X (2020) Ignition of thin fuel by thermoplastic drips: An experimental study for the dripping ignition theory. *Fire Saf J* 115:103006
34. Zhou B, Yoshioka H, Noguchi T, Ando T (2018) Numerical prediction of mass loss rate of expanded polystyrene (EPS) used for external thermal insulation composite systems (ETICS) in cone calorimeter. *Fire Mater* 42:517–526
35. Pečur IB, Bjegović D, Boström L, Milovanović B, Hajduković M (2015) ETICS fire performance test. *International Workshop on Performance, Protection & Strengthening of Structures Under Extreme Loading* (5; 2015)
36. Yamaguchi J-i, Tanaka T (2005) Temperature profiles of window jet plume. *Fire Sci Technol* 24:17–38
37. Architectural Institute of Japan (2018) Handbook on design calculation methods of fire behavior. Tokyo, Japan, Architectural Institute of Japan Press (In Japanese)
38. Harper CA (2004) Handbook of building materials for fire protection. McGraw-Hill, New York
39. Zhou B, Yoshioka H, Noguchi T, Wang K (2020) Experimental study of time-averaged upward fire propagation speed (FPS) of EPS ETICS masonry façade exposed to various window spilled flames. *Fire Mater* 45(2):193–204

**Publisher's Note** Springer Nature remains neutral with regard to jurisdictional claims in published maps and institutional affiliations.